

Factory-Verified Replacement

MERYDOM 10-16 0179/0-06672

Certified for interchange with IMO 10-16 0179/0-06672.
This document consolidates the public product record,
complete published specifications, technical media,
source traceability and engineering confirmation notes.

LEVEL 3 - MERYDOM ENGINEERING VERIFIED

Reviewed by MERYDOM Engineering Department. Final application approval must confirm loads, duty cycle, mounting rigidity, bolt capacity, lubrication and operating conditions.

MERYDOM MODEL

10-16 0179/0-06672

REFERENCE

IMO 10-16 0179/0-06672

SERIES

OTHER_STANDARD_BALL Series

STRUCTURE

D rt nokta temasl bilyal

OVERALL OD

mm

OVERALL ID

mm


OVERALL HEIGHT

mm

GEAR

Di lisiz

Published Technical Drawing

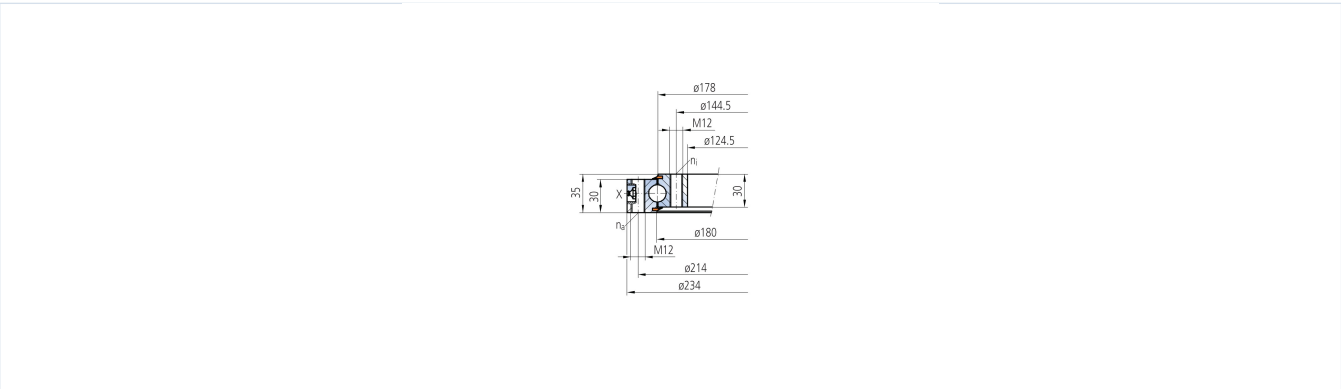

imo-10160179006672-drawing.webp

Complete Product Data

All values below are generated from the current public verified replacement record. Source values are retained and metric references are shown where available.

MERYDOM CERTIFIED PRODUCT	
Product brand	MERYDOM
MERYDOM model	10-16 0179/0-06672
Certified interchangeable with	IMO 10-16 0179/0-06672
Verification status	Level 3 - MERYDOM Engineering Verified
Reviewed by	MERYDOM Engineering Department
Public record UID	RCU3RYPUNMDMMWT2ECSDKJC5EN
MATERIALS	
Configurable ring material options	42CrMo / 50Mn
Seal material	NBR - Nitrile rubber
Configurable spacer material options	Engineering nylon / Brass
IDENTIFICATION	
Reference brand	IMO
Reference series	OTHER_STANDARD_BALL Series
Reference model	10-16 0179/0-06672
Bearing structure	D rt nokta temasl bilyal
Gear arrangement	Di lisiz
DIMENSION	
Assembly weight (G)	7 kg
MOUNTING	
Outer ring mounting-hole count (na)	12

Complete Product Data

All values below are generated from the current public verified replacement record. Source values are retained and metric references are shown where available.

MOUNTING (CONTINUED)	
Inner ring mounting-hole count (ni)	12
PERFORMANCE	
Static radial load rating (Co_rad)	78 kN
Static axial load rating (Co_ax)	209 kN
Dynamic radial load rating (C_rad)	89 kN
Dynamic axial load rating (C_ax)	103 kN
PERFORMANCE RATINGS	
Co Rad	78 kN Not simultaneous with other listed dynamic ratings
Co Ax	209 kN Not simultaneous with other listed dynamic ratings
C Rad	89 kN Not simultaneous with other listed dynamic ratings
C Ax	103 kN Not simultaneous with other listed dynamic ratings
MOUNTING INTERFACES	
Outer ring mounting	12 holes - See source drawing
Inner ring mounting	12 holes - See source drawing
GEAR INTERFACE	
Integral gear	Not applicable - ungeared bearing
SOURCE TRACEABILITY	
Source document code	IMO_OTHER_STANDARD_BALL_EN
Source file	imo_weitere_standard-kugeldrehverbindungen-en.pdf
PDF page	3


Complete Product Data

All values below are generated from the current public verified replacement record. Source values are retained and metric references are shown where available.

SOURCE TRACEABILITY (CONTINUED)	
Printed page	Not published
Source language	EN
Original unit system	Metric
PUBLISHED TECHNICAL MEDIA	
Load Curve Chart	imo-10160179006672-curve.webp SHA-256: 354784548bf7874d69bd0ed7a77600efc874fe2f6d61ba57d82a0f75aa00c90d
Outline Drawing	imo-10160179006672-drawing.webp SHA-256: 915f6c2f54fd83210d44d0fa7606dc7c9fe1c06c8ba74463ef33150fc2d92b8d

Published Load / Performance Chart

Use the published chart as a preliminary selection aid only. The model legend, curve family and source document must be reviewed together with the operating load case.

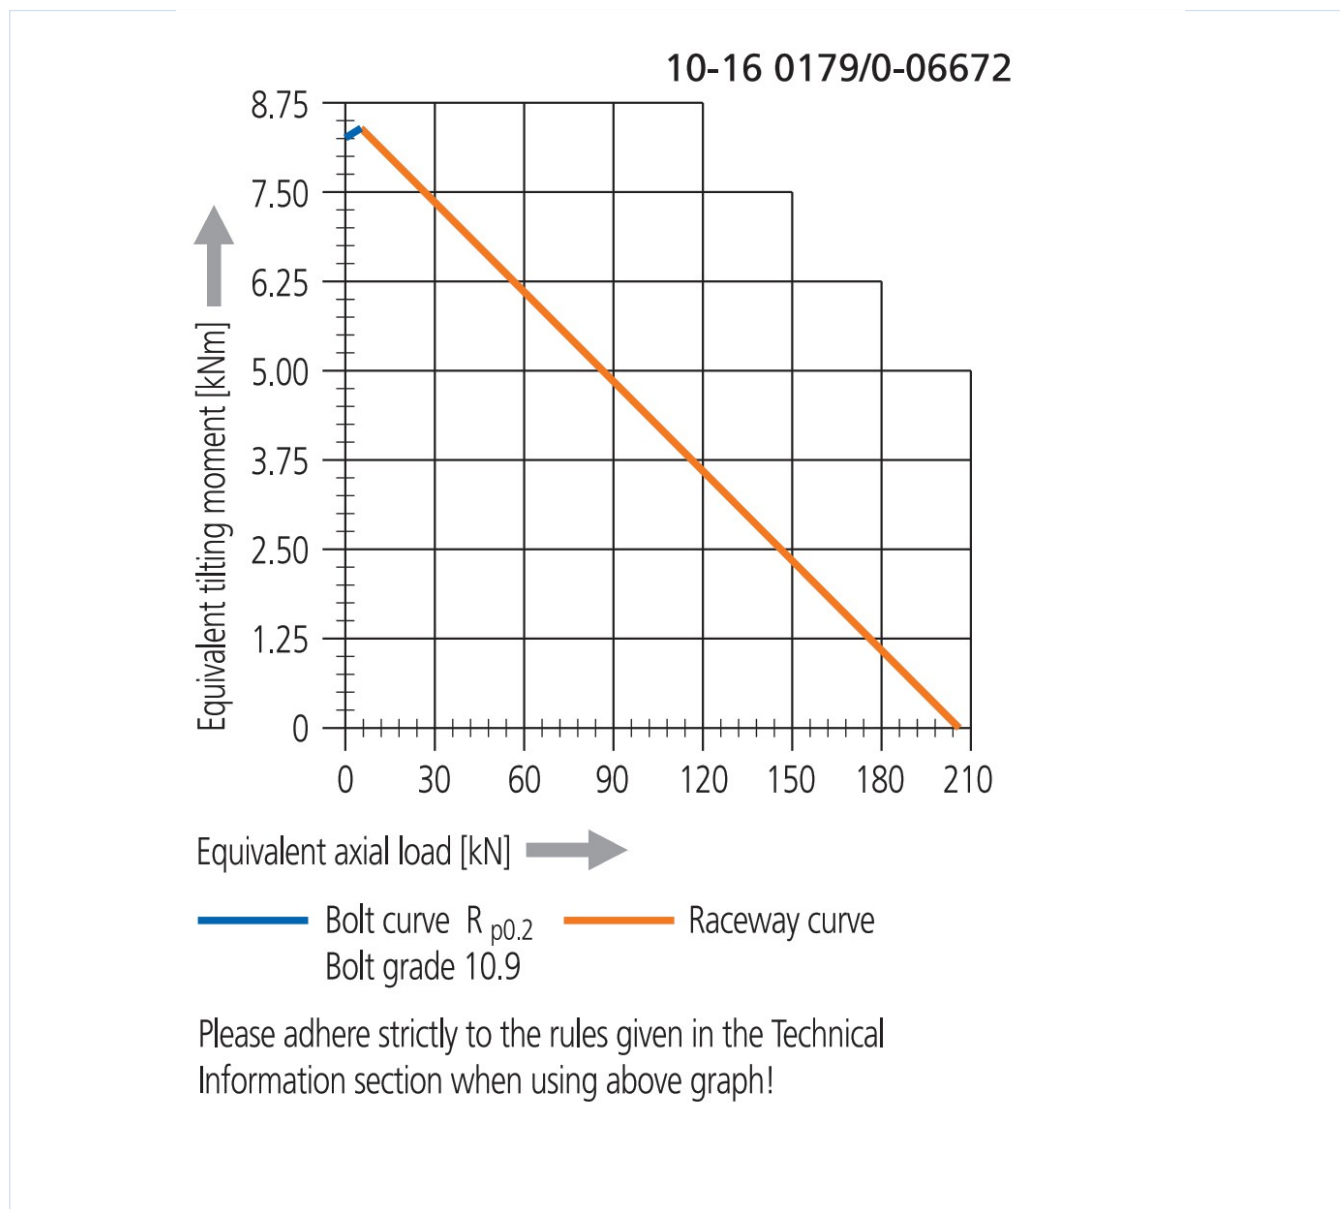

imo-10160179006672-curve.webp | SHA-256: 354784548bf7874d69bd0ed7a77600efc874fe2f6d61ba57d82a0f75aa00c90d

Engineering note: final approval must also consider mounting rigidity, bolt capacity, duty cycle, lubrication, temperature, environment and installation conditions.

Source and Verification Traceability

PUBLIC RECORD UID

RCU3RYPUNMDMMWT2ECSDKJC5EN

SOURCE DOCUMENT

IMO_OTHER_STANDARD_BALL_EN

SOURCE FILE

imo_weitere_standard-kugeldrehverbin
dungen-en.pdf

SOURCE LOCATION

PDF page 3 | Printed page Not
published

VERIFICATION

Level 3 - MERYDOM Engineering
Verified

REVIEWED BY

MERYDOM Engineering Department

Engineering Confirmation Boundary

- 1 Confirm the exact model designation and all installation-envelope dimensions.
- 2 Confirm mounting-hole quantity, bolt circle, hole specification, bolt grade and preload.
- 3 Confirm gear arrangement, pitch system, tooth count, backlash and mating-pinion data.
- 4 Confirm axial, radial and moment loads, load combinations, duty cycle and required life.
- 5 Confirm support flatness and stiffness, lubrication, sealing, temperature and environment.
- 6 Final drawing revision, manufacturing tolerances and documentation package are confirmed with the quotation.

Request Price, Delivery and Final Engineering Confirmation

Email: jovi@merydom.com | Email: andi@merydom.com | WhatsApp: +86 17705201170

Product page: <https://rotnex.com/tr/urunler/muadil-doner-tabla-rulmanlari/imo/10-16-0179-0-06672/>

Trademark and legal notice: referenced brand and model names are used only for identification and cross-reference. MERYDOM is an independent manufacturer and is not affiliated with or endorsed by the referenced brand unless expressly stated.